



SQUARE FOOTAGE:	
FIRST FLOOR:	2007
GARAGE:	1131
COVERED PORCH:	200
FINISHED BASEMENT:	1128



REAR ELEVATION
SCALE: 1/8" = 1'-0"

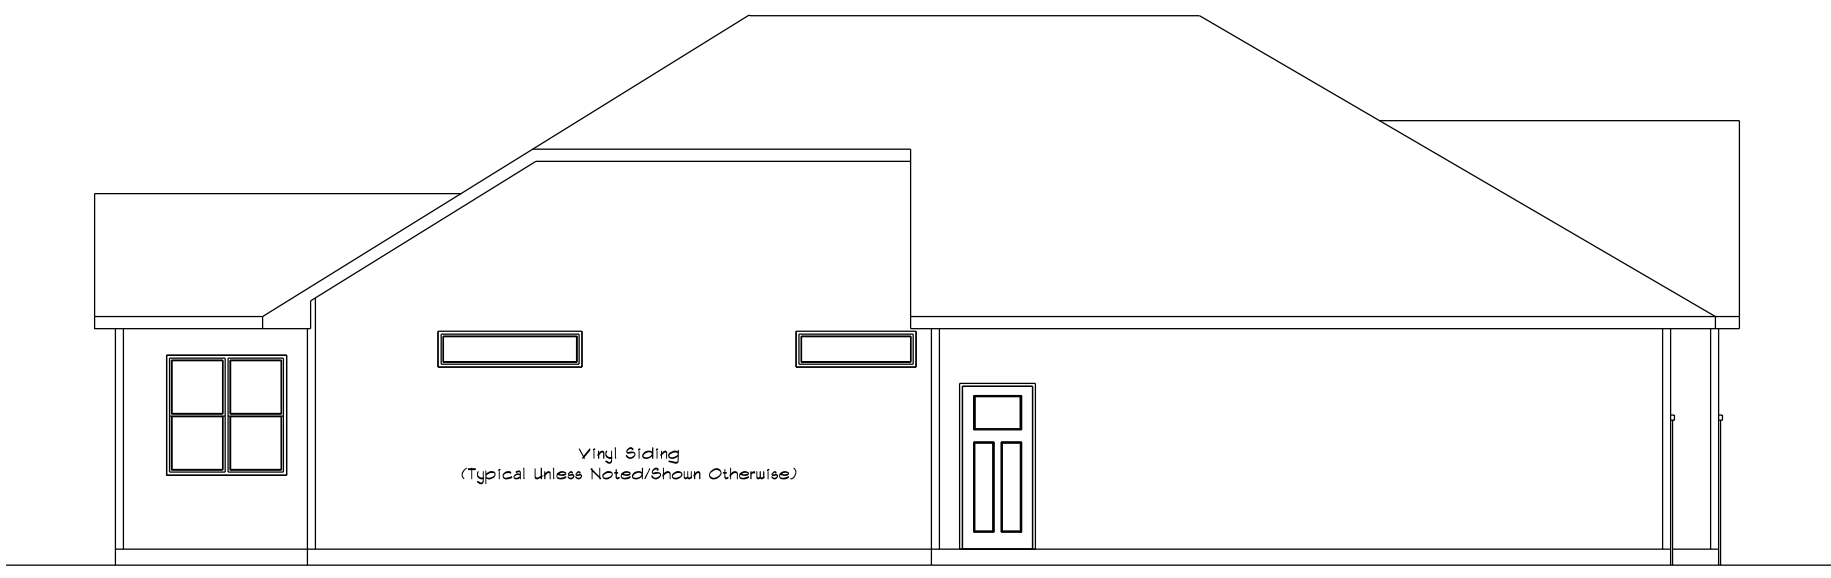

LEFT ELEVATION
SCALE: 1/8" = 1'-0"

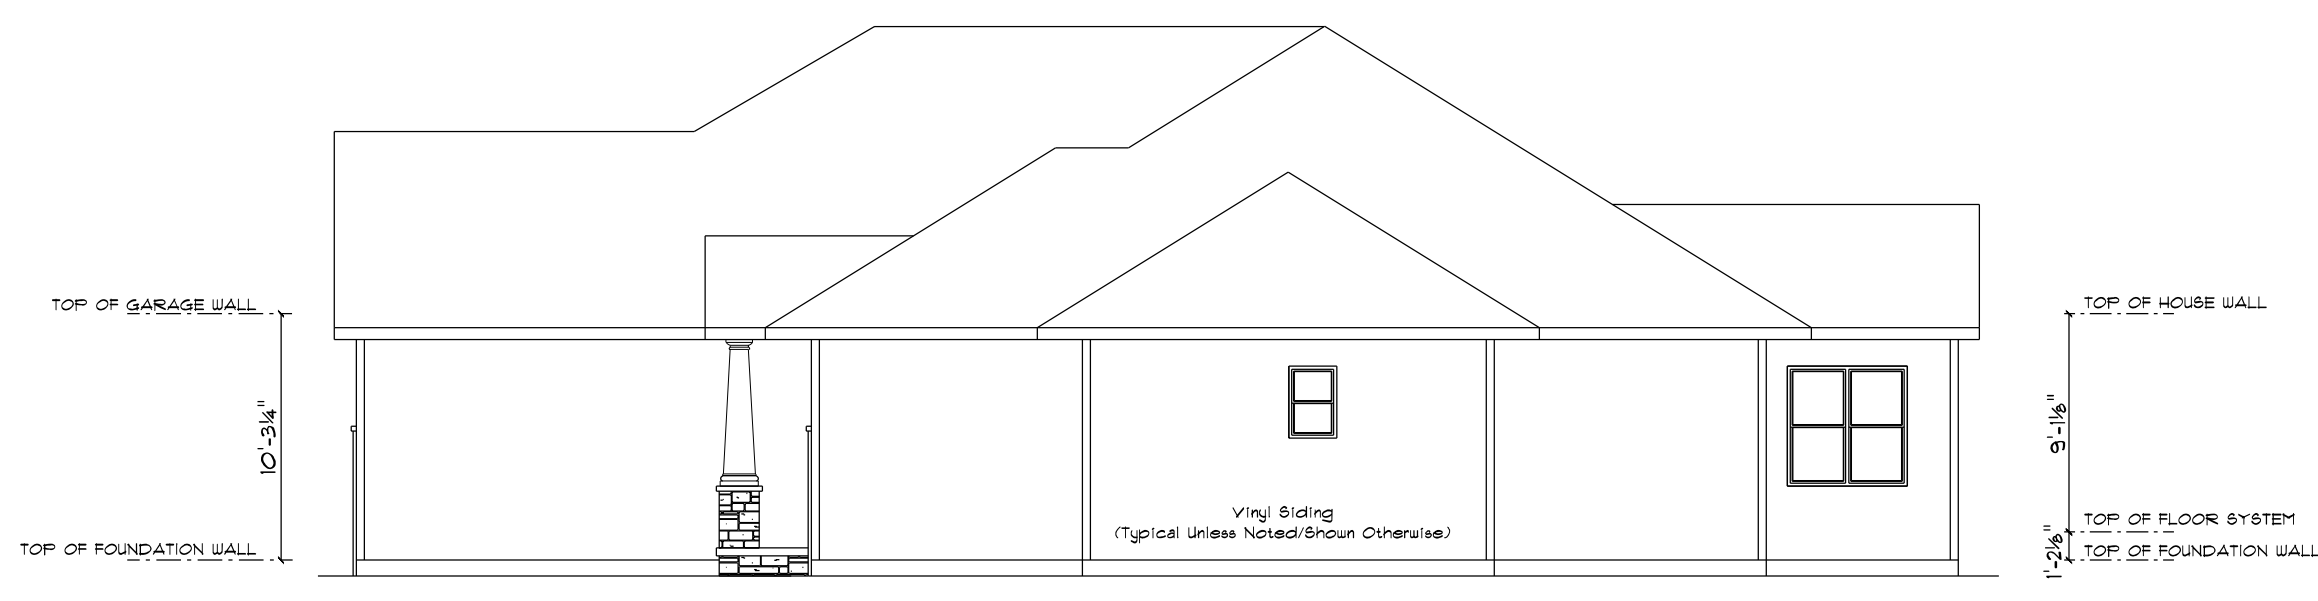

RIGHT ELEVATION
SCALE: 1/8" = 1'-0"



FRONT ELEVATION
SCALE: 1/4" = 1'-0"

CUSTOM DESIGNED FOR:

JOB NAME:	568 JWBK 4 JILL Basement Steps
DATE:	MAY 9, 2022
DRAWN BY:	Chris Schuette
REVISIONS:	11/22 BY
PLAN #:	22-119-R
	(BASED OFF OF PLAN SHEET)

STAY GREEN BAY


IMPORTANT NOTE:


- IT IS AGREED THAT ALTHOUGH EVERY EFFORT HAS BEEN MADE IN PREPARING AND CHECKING THESE PLANS FOR ACCURACY, THE GENERAL CONTRACTOR/OWNER MUST REVIEW ALL DIMENSIONS, DETAILS AND NOTES BEFORE BEGINNING ANY CONSTRUCTION AND IS HEREBY HELD RESPONSIBLE FOR ANY DISCOVERED DISCREPANCIES.
- IT IS UNDERSTOOD THAT THE WISCONSIN SAFETY AND PROFESSIONAL SERVICES CODE AND LAYOUT DRAWINGS FOR FLOOR AND ROOF TRUSSES SHALL TAKE FINAL PRECEDENCE OVER THESE ARCHITECTURAL PLANS.

MAILING ADDRESS:
P.O. BOX 10001
GREEN BAY, WI 54307-0001

OFFICE:
GREEN BAY, WI 54303
PHONE (920)436-5080
FAX (920)434-9570

COMPONENTS:
GREEN BAY, WI 54303
PHONE (920)436-5080
FAX (920)434-9570

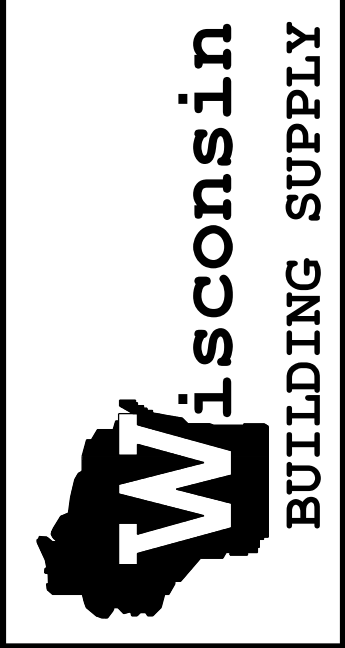

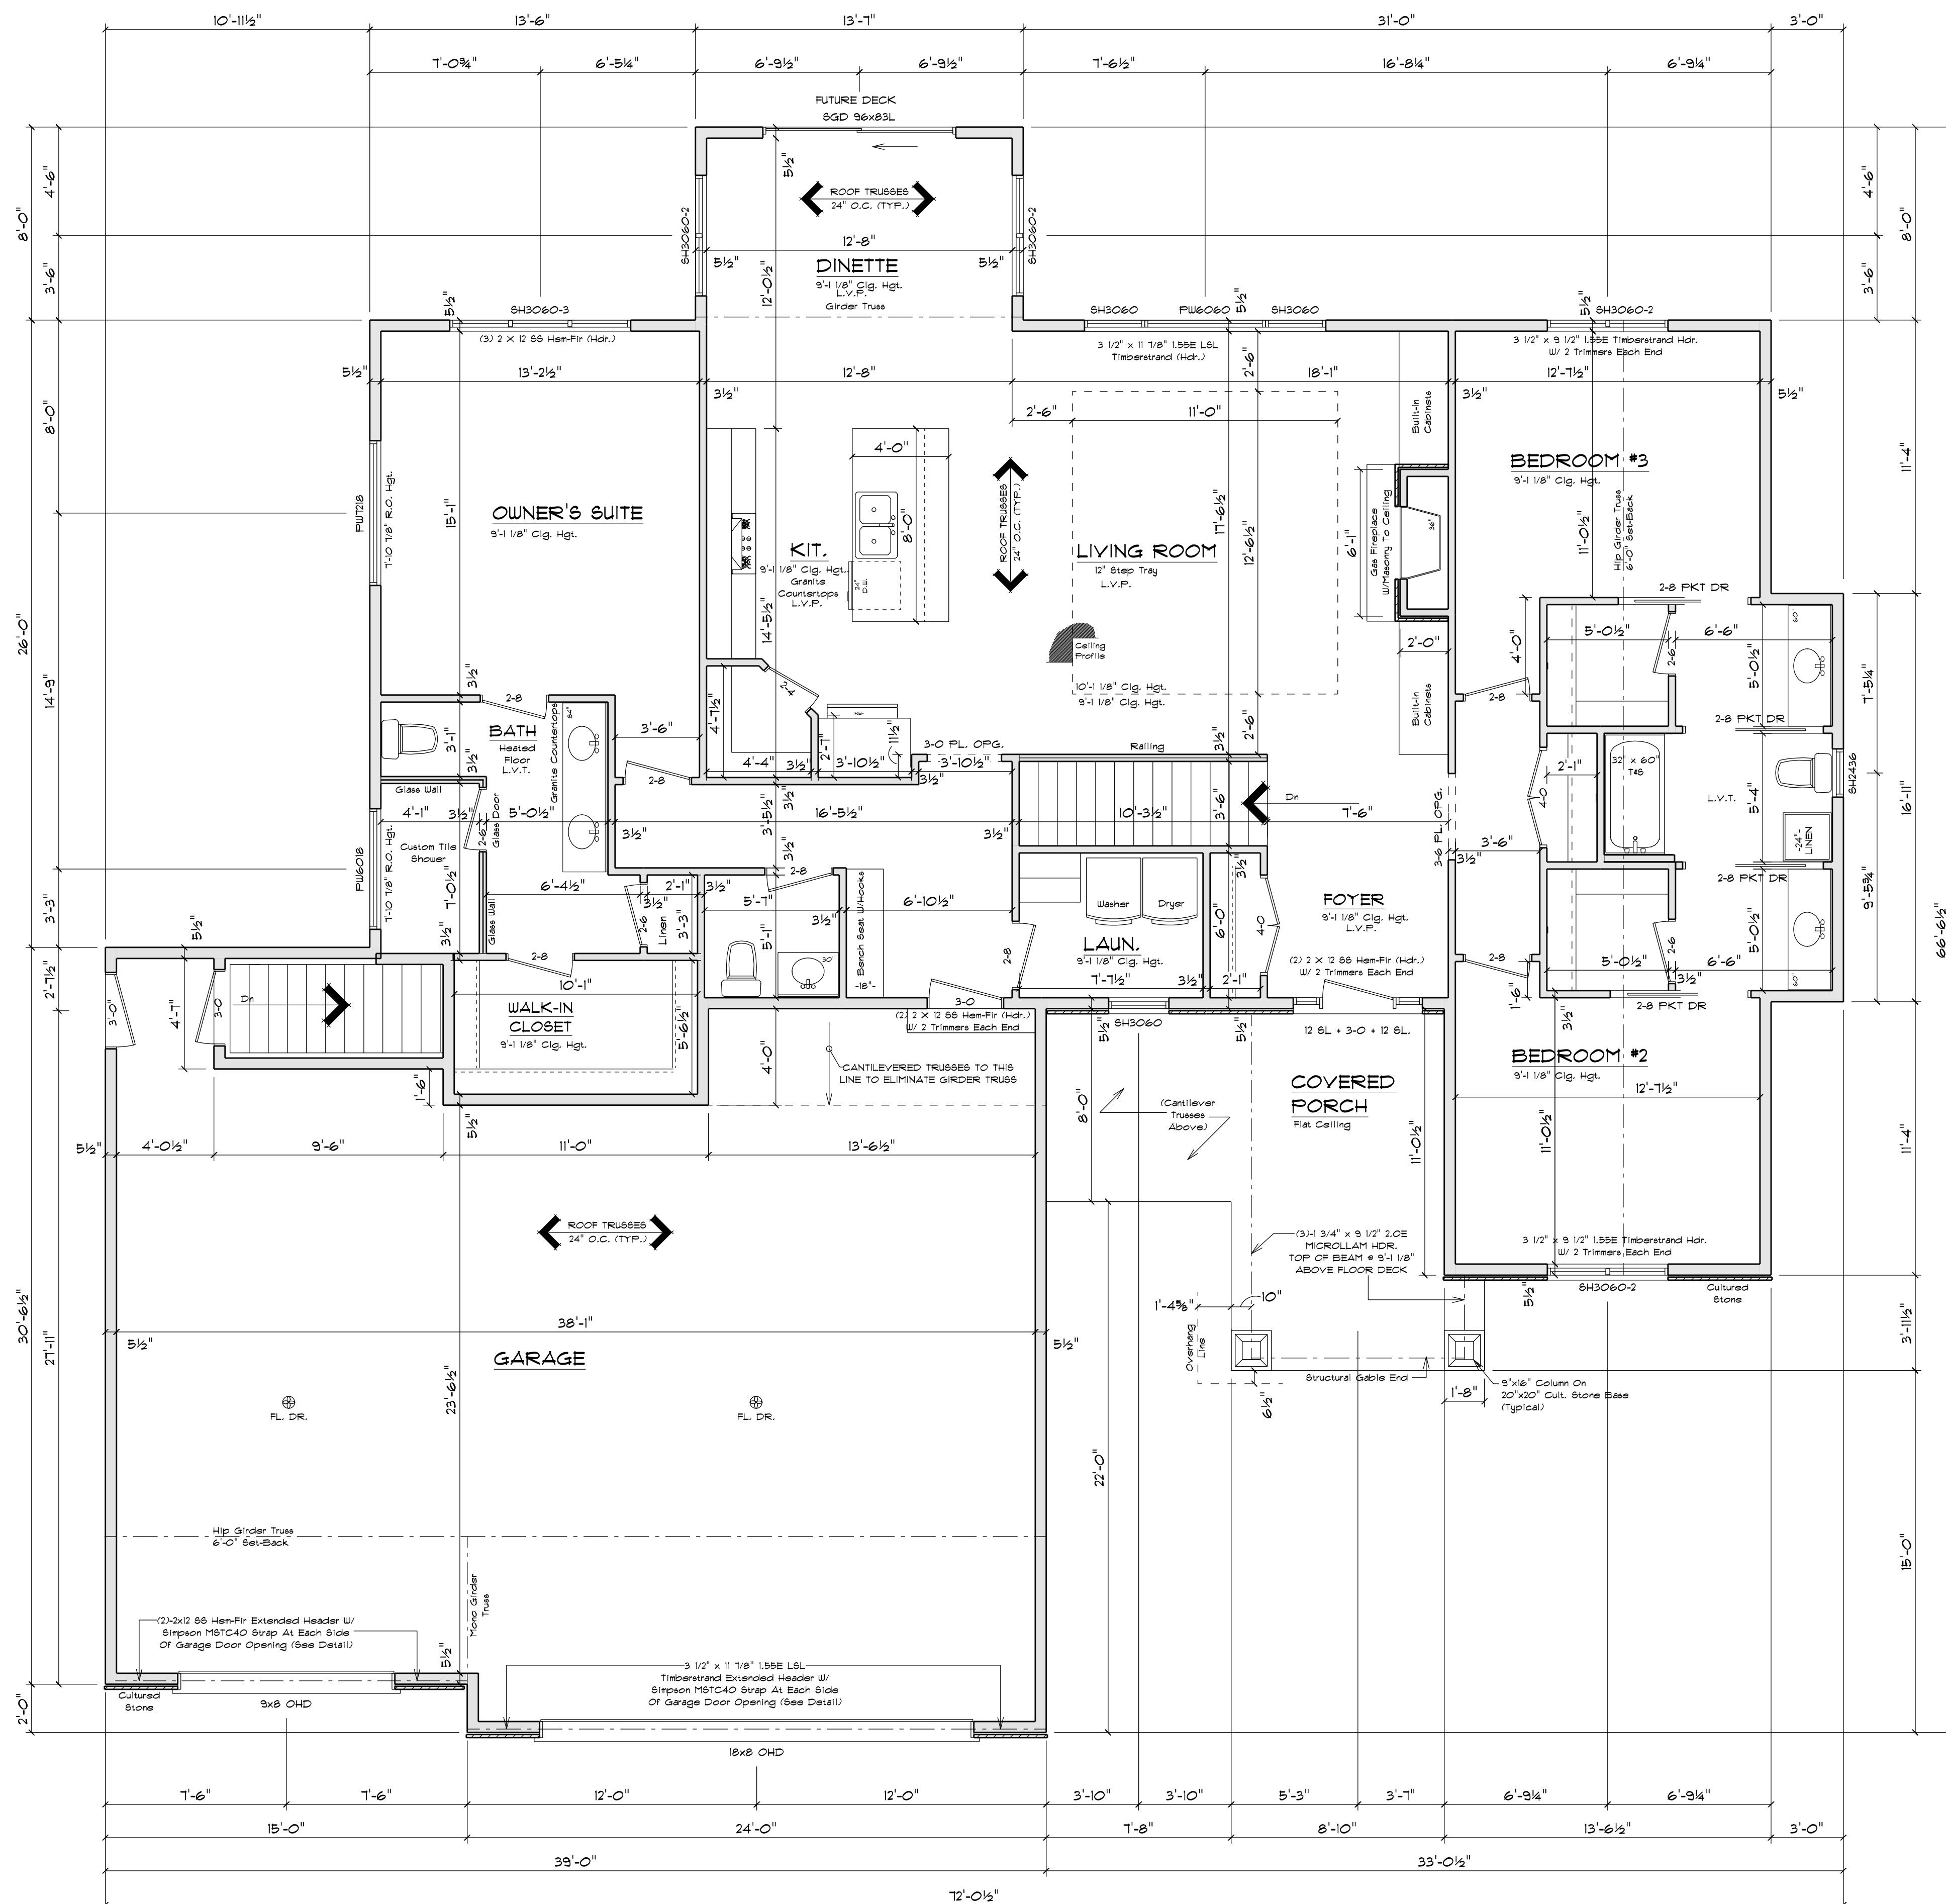

SQUARE FOOTAGE:

FIRST FLOOR:	2007
GARAGE:	1131
COVERED PORCH:	200
FINISHED BASEMENT:	1128

PLAN SPECIFICATIONS:

THE CONDITIONS LISTED BELOW ARE STANDARD FOR THIS PLAN ONLY. EXCEPTIONS ARE NOTED ON THE PLAN ITSELF.

WALL INFORMATION:
 HOUSE FOUNDATION: 8" X 8"-0" FOURS CONCRETE
 GARAGE FOUNDATION: 8" X 8"-0" FOURS CONCRETE
 PORCH/PATIO FOUNDATION: 6" FOURS CONCRETE, MIN. 4'-0" TALL
 HOUSE EXTERIOR: FIRST FLOOR: 2 X 6 X 9'-1 1/8" STUDS @ 16" O.C.
 HOUSE INTERIOR: FIRST FLOOR: 2 X 4 X 9'-1 1/8" STUDS @ 16" O.C.
 GARAGE: 2 X 6 X 10'-9 3/8" STUDS @ 16" O.C.
 TALL WALLS ARE EXTERIOR WALLS WITH STUDS TALLER THAN 10'-0" AND NEED TO BE DESIGNED BY ENGINEERED WOOD PRODUCTS SUPPLIER.
 TAPERED WALLS ARE TO BE FRAMED TO UNDERSIDE OF 6056060 ROOF TRUSSES.

STAIR INFORMATION:
 BASEMENT TO FIRST FLOOR:
 14 RISERS @ 7 3/16" - 13 TREADS @ 9 1/2"
 BASEMENT TO GARAGE:
 12 RISERS @ 7 1/16" - 11 TREADS @ 9 1/2"

FLOOR SYSTEM(S):
 BASEMENT:
 4" REINFORCED CONCRETE SLAB
 FIRST FLOOR:
 11 7/8" I-1018TS @ 16" O.C.
 STD. LOADING (PER SQ. FT.)
 40' LL 10' DL
 ADDITIONAL LOADING (PER SQ. FT.)
 10' DL FOR TILE FLOOR
 20' DL FOR GRANITE
 DEFLECTION: LLU/480 DLU/240
 DURATION OF LOAD: 1.00%
 FRAMER TO REFERENCE JOIST/TRUSS LAYOUT PLANS TO VERIFY EXACT SIZE AND LOCATION OF ALL FLUSH HEADERS AND BEAMS IN FLOOR SYSTEM.

ROOF SYSTEM:
 ENGINEERED WOOD TRUSSES @ 24" O.C.
 DESIGNED FOR BRUN COUNTY - ZONE 2
 STD. LOADING (PER SQ. FT.)
 30' TOLL, 10' TCOL, 10' BCCL
 DEFLECTION: LLU/240 DLU/120
 DURATION OF LOAD: 1.5%
 FRAMER TO REFERENCE TRUSS LAYOUT PLANS TO VERIFY EXACT LOCATIONS OF GIRDER TRUSSES AND THEIR RESPECTIVE BEARING REQUIREMENTS & ULTIMATE ANCHORING REQUIREMENTS.
HEADERS:
 6" STD. HEADERS; (2) 2X12 HEM-FIR SELECT STRUCTURAL
 TOP OF WINDOW R.O.S.
 FIRST FLOOR @ 6'-0" 1/8" ABOVE SUBFLOOR
 MINIMUM OF (2) TRIM STUDS AT EACH END FOR ALL OPENINGS 6'-0" AND LARGER.

WINDOWS:
 ALLIANCE VINYL SINGLE HUNG
 MANUFACTURER TO PROVIDE SUPPLIER WITH EXACT R.O.S. SIZES AND DETAILS. SUPPLIER TO VERIFY THAT ALL CODE REQUIREMENTS ARE MET.

GENERAL INFORMATION:

- THE FOLLOWING ITEMS ARE TO BE LOCATED IN THE FOUNDATION BY THE GENERAL CONTRACTOR:
 BASEMENT WINDOWS FLOOR DRAINS
 ELECTRIC SERVICES WATER HEATER
 SUMP PIT & FURNACE
- BUILDER TO PROVIDE HEADERS AT CONCRETE OPENINGS IF NOT NOTED ON THE FOUNDATION PLAN
- FOUNDED CONCRETE FOOTINGS TO BEAR ON UNDISTURBED SOIL BELOW THE FROST LINE
- STEEL COLUMNS TO SUPPORT 22000#
- INTERIOR BEARING WALLS TO SIT ON CONTINUOUS CONCRETE FOOTINGS, STUDS @ 16" O.C. WITH BLOCKING OR LATERAL BRACING
- CONCRETE CONTRACTOR AND BUILDER ARE RESPONSIBLE TO DETERMINE SITE SOIL CONDITIONS AND FOLLOW STANDARDS PER 898 320.24. THE MOST RESTRICTIVE STANDARDS OF 898 32.5 - 898 32.8, ACI 318.14, AND ACI 332-14 FOR ALL FOOTING & WALL REINFORCEMENT. IF NEEDED, MUST BE FOLLOWED.
- ASSUMED SOIL CAPACITY IS 3,000 PSF. FTG. SIZES MUST BE ADJUSTED FOR VARYING SITE DETERMINED SOIL BEARING CONDITIONS
- ALL LUMBER IN FERMENT CONTACT W/ CONCRETE MUST BE PRESSURE TREATED LUMBER AS PER 898 321.10
- DUE TO UNKNOWN GRADE CONDITIONS, ACTUAL STEPS IN FOUNDATION WALLS AND LOCATION OF WINDOW WELLS TO BE DETERMINED ON SITE BY GENERAL CONTRACTOR
- FRAMER IS RESPONSIBLE FOR TRANSFERRING POINT LOADS FROM ABOVE THROUGH THE FLOOR SYSTEM(S) AND WALLS W/ SOLID BLOCKING DOWN TO CONCRETE FOUNDATION WALLS BELOW
- PLAN IS DRAWN ACCORDINGLY FOR 2 3/4" CASING
- ALL DIMENSIONS SHOWN ARE FROM STUD TO STUD
- BUILDER TO PROVIDE ATTIC SCUTTLE AND LOCATION
- FIRE SEPARATION MUST BE PROVIDED BETWEEN HOUSE AND GARAGE (SEE CODE FOR DETAILS)
- ALL CABINET LAYOUTS ARE CONCEPTUAL. CONSULT CABINET DESIGNER/ PROVIDER FOR EXACT SIZES AND LOCATIONS OF CABINETS, APPLIANCES, AND WINDOWS

CUSTOMER DESIGNED FOR: **STAY GREEN BAY**

JOB NAME: 558 Job # Jill, Basement Steps
 DATE: MAY 9, 2022
 REVISIONS:
 1/022 BY
 DRAIN BY: Chris Schuette
 PLAN #:
 22-119-R
 (BASED OFF OF PLAN SHEET)

STAY GREEN BAY

IMPORTANT NOTE:

IT IS AGREED THAT ALTHOUGH EVERY EFFORT HAS BEEN MADE IN PREPARING AND CHECKING THESE PLANS FOR ACCURACY, THE GENERAL CONTRACTOR/OWNER MUST REVIEW ALL DIMENSIONS, DETAILS AND NOTES BEFORE BEGINNING ANY CONSTRUCTION AND IS HEREBY HELD RESPONSIBLE FOR ANY DISCOVERED DISCREPANCIES.

IT IS UNDERSTOOD THAT THE WISCONSIN SAFETY AND PROFESSIONAL SERVICES CODE AND LAYOUT DRAWINGS FOR FLOOR AND ROOF TRUSSES SHALL TAKE PRECEDENCE OVER THESE ARCHITECTURAL PLANS.


MAILING ADDRESS:
 P.O. BOX 10001
 GREEN BAY, WI 54307-10001

OFFICE:
 WISCONSIN
 GREEN BAY, WI 54303
 PHONE (920)436-5080
 FAX (920)436-5084


COMPONENTS:
 TRUSSES
 GREEN BAY, WI 54303
 PHONE (920)436-5084
 FAX (920)436-5084

FLOOR PLAN
 SCALE: 1/4" = 1'-0"
 9'-1 1/8" CLG. HGT.

NOTE:
 EXTERIOR DIMENSIONS ARE SHOWN TO REFLECT HOUSE FRAMING WALLS HELD OUT 1/2" FOR EXTERIOR WALL SHEATHING TO FLUSH OUT WITH 1" FOUNDATION FOAM.

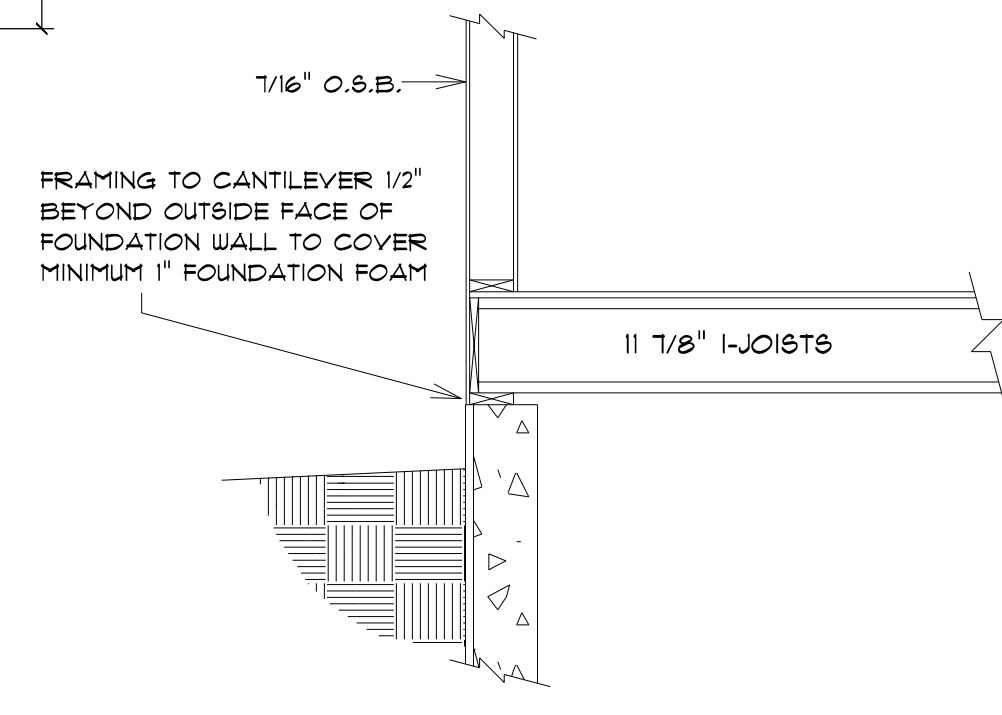

BOX SILL DETAIL
 SCALE: 1/2" = 1'-0"

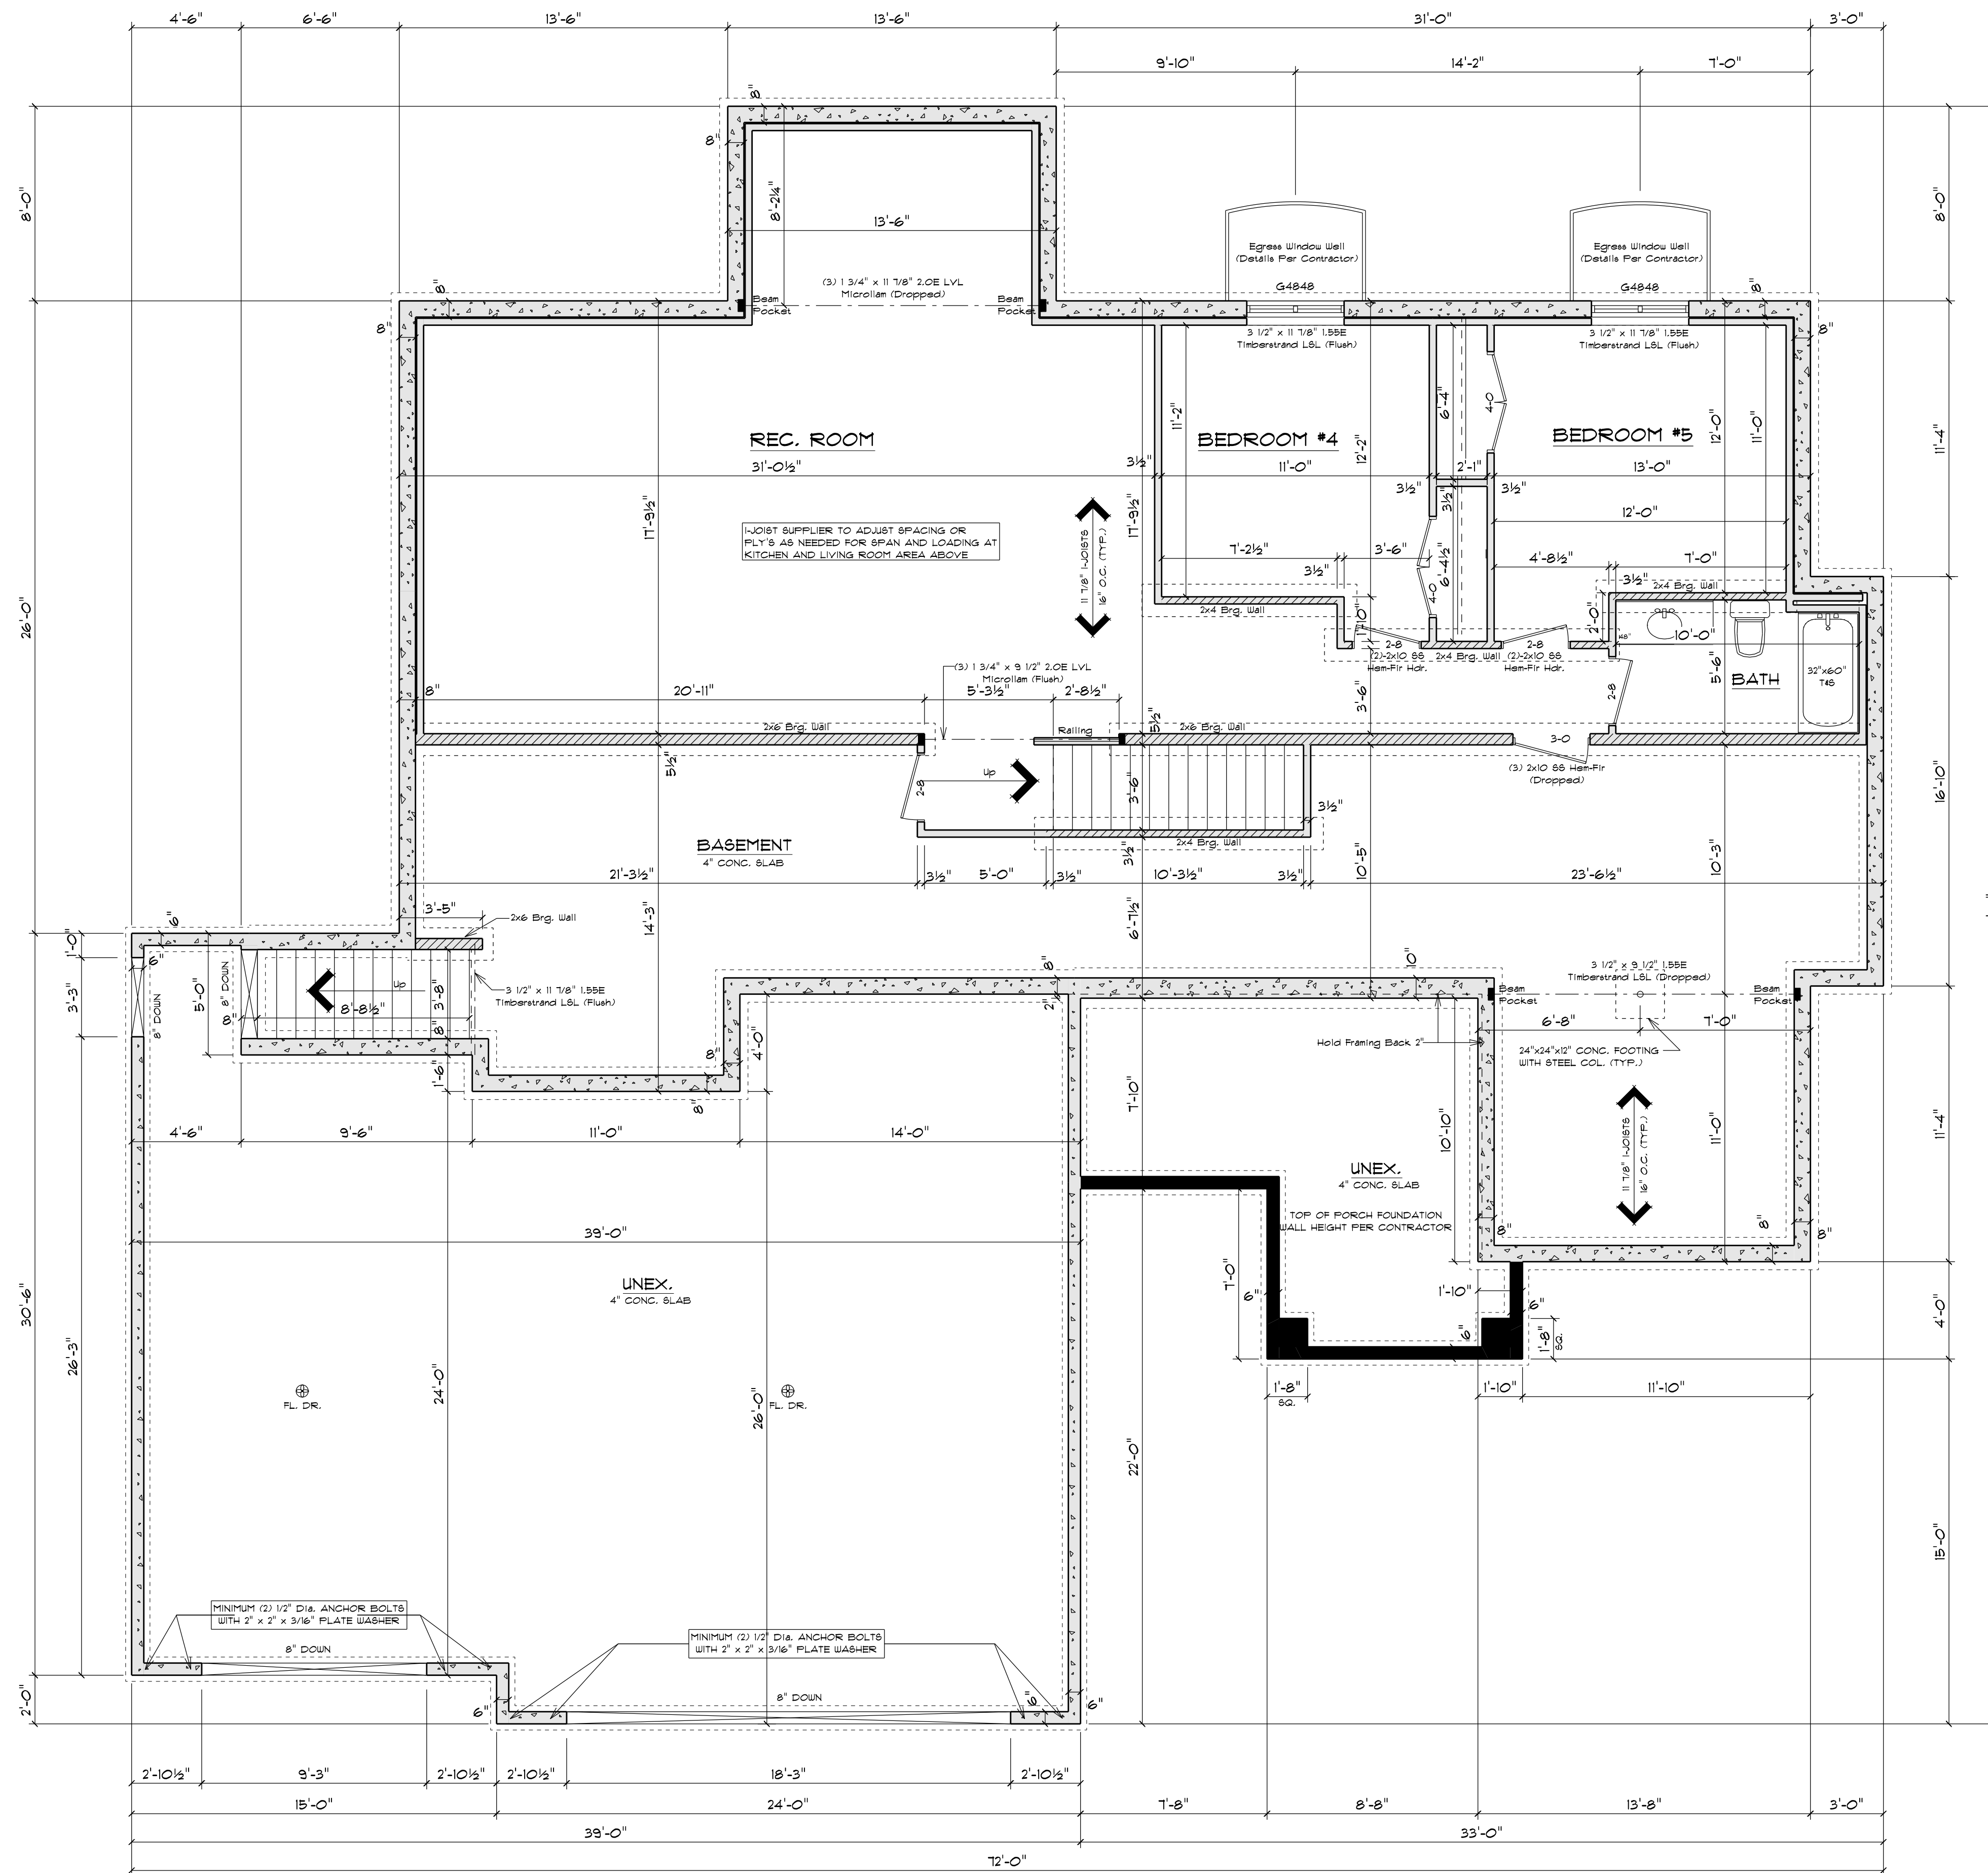

FOUNDATION PLAN

SCALE : 1/4" = 1'-0"
 8'-0" FOUNDATION WALL HGT.

NOTE:
 EXTERIOR DIMENSIONS ARE TO FACE OF FOUNDATION WALLS. EXTERIOR FRAMED HOUSE WALLS ARE TO BE HELD OUT 1/2" TO FLUSH WALL SHEATHING OUT WITH 1" FOUNDATION FOAM

ALL WINDOW, KNEE-WALL, AND FULL WALL-CUT HEIGHTS AND LOCATIONS TO BE VERIFIED DUE TO GRADE CONDITIONS

SQUARE FOOTAGE:

FIRST FLOOR:	2007
GARAGE:	1131
COVERED PORCH:	200
FINISHED BASEMENT:	1128

PLAN SPECIFICATIONS:

THE CONDITIONS LISTED BELOW ARE STANDARD FOR THIS PLAN ONLY. EXCEPTIONS ARE NOTED ON THE PLAN ITSELF.

WALL INFORMATION:
 HOUSE FOUNDATION: 8" x 8'-0" FOURS CONCRETE
 GARAGE FOUNDATION: 4" x 4'-0" FOURS CONCRETE
 PORCH/PATIO FOUNDATION: 6" FOURS CONCRETE, MIN. 4'-0" TALL
 HOUSE EXTERIOR: FIRST FLOOR: 2 x 6 x 9'-1 1/8" STUDS @ 16" O.C.
 HOUSE INTERIOR: FIRST FLOOR: 2 x 4 x 9'-1 1/8" STUDS @ 16" O.C.
 GARAGE: 2 x 6 x 10'-9 3/8" STUDS @ 16" O.C.
 TALL WALLS ARE EXTERIOR WALLS WITH STUDS TALLER THAN 10'-0" AND NEED TO BE DESIGNED BY ENGINEERED WOOD PRODUCTS SUPPLIER.
 TAPERED WALLS ARE TO BE FRAMED TO UNDERSIDE OF 6056069 ROOF TRUSSES.

STAIR INFORMATION:
 BASEMENT TO FIRST FLOOR: 14 RISERS @ 7 3/8" - 13 TREADS @ 9 1/2"
 BASEMENT TO GARAGE: 2 RISERS @ 11 1/4" - 11 TREADS @ 9 1/2"

FLOOR SYSTEM(S):
 BASEMENT: 4" REINFORCED CONCRETE SLAB
 FIRST FLOOR: 11 7/8" I-JOISTS @ 16" O.C.
 STD. LOADING (PER SQ. FT.): 40' LL 10' DL
 ADDITIONAL LOADING (PER SQ. FT.): 10' DL FOR TILE FLOOR
 20' DL FOR GRANITE
 DEFLECTION: LL/480 DL/240
 DURATION OF LOAD: 1.00P
 FRAMER TO REFERENCE 1018/1788 LAYOUT PLANS TO VERIFY EXACT SIZE AND LOCATION OF ALL FLUSH HEADERS AND BEAMS IN FLOOR SYSTEM


ROOF SYSTEM:
 ENGINEERED WOOD TRUSSES @ 24" O.C.
 DESIGNED FOR BRUN COUNTY - ZONE 2
 STD. LOADING (PER SQ. FT.): 30' TCDL 10' BCDL
 DEFLECTION: LL/480 DL/480
 DURATION OF LOAD: 1.5P
 FRAMER TO REFERENCE TRUSS LAYOUT PLANS TO VERIFY EXACT LOCATIONS OF GIRDERS TRUSSES AND THEIR RESPECTIVE BEARING REQUIREMENTS & UPLIFT ANCHORING REQUIREMENTS

HEADERS:
 STD. HEADERS: (2) 2X12 HEM-FIR SELECT STRUCTURAL
 TOP OF WINDOW R.O.S.
 FIRST FLOOR @ 6'-10 1/8" ABOVE SUBFLOOR
 MINIMUM OF (2) TRIM STUDS AT EACH END FOR ALL OPENINGS 6'-0" AND LARGER

WINDOWS:
 ALLIANCE VINYL SINGLE HUNG
 MANUFACTURER TO PROVIDE SUPPLIER WITH EXACT R.O. SIZES AND DETAILS. SUPPLIER TO VERIFY THAT ALL CODE REQUIREMENTS ARE MET.

GENERAL INFORMATION:
 THE FOLLOWING ITEMS ARE TO BE LOCATED IN THE FOUNDATION BY THE GENERAL CONTRACTOR:
 BASEMENT WINDOWS FLOOR DRAINS
 ELECTRIC SERVICES WATER HEATER
 SUMP PIT & FURNACE
 BUILDER TO PROVIDE HEADERS AT CONCRETE OPENINGS
 IF NOT NOTED ON THE FOUNDATION PLAN
 GENERAL CONTRACTOR/OWNER MUST REVIEW ALL DIMENSIONS, DETAILS AND NOTES BEFORE BEGINNING ANY CONSTRUCTION AND IS HEREBY HELD RESPONSIBLE FOR ANY DISCOVERED DISCREPANCIES.
 CONCRETE CONTRACTOR AND BUILDER ARE RESPONSIBLE TO DETERMINE SITE SOIL CONDITIONS AND FOLLOW STANDARDS PER SP8 320.24. THE MOST RESTRICTIVE STANDARDS OF SP8 32.5 - SP8 32.18, ACI 318.4, AND ACI 332-14 FOR ALL FOOTING & WALL REINFORCEMENT. IF NEEDED, MUST BE FOLLOWED.
 ASSUMED SOIL CAPACITY IS 3,000 PSF. FTG. SIZES MUST BE ADJUSTED FOR VARYING SITE DETERMINED SOIL BEARING CONDITIONS.
 ALL LUMBER IN PERMANENT CONTACT W/ CONCRETE MUST BE PRESSURE TREATED LUMBER AS PER U1 SP8 32.10 DUE TO UNKNOWN GRADE CONDITIONS. ACTUAL STEPS IN FOUNDATION WALLS AND LOCATION OF WINDOW WELLS TO BE DETERMINED ON SITE BY GENERAL CONTRACTOR.
 FRAMER IS RESPONSIBLE FOR TRANSFERRING POINT LOADS FROM ABOVE THROUGH THE FLOOR SYSTEM(S) AND WALLS W/ SOLID BLOCKING DOWN TO CONCRETE FOUNDATION WALLS BELOW.
 PLAN IS DRAWN ACCORDINGLY FOR 2 3/4" CASING
 ALL DIMENSIONS SHOWN ARE FROM STUD TO STUD
 BUILDER TO PROVIDE ATTIC SCUTTLE AND LOCATION
 FIRE SEPARATION MUST BE PROVIDED BETWEEN HOUSE AND GARAGE (SEE CODE FOR DETAILS)
 ALL CABINET LAYOUTS ARE CONCEPTUAL. CONSULT CABINET DESIGNER/ PROVIDER FOR EXACT SIZES AND LOCATIONS OF CABINETS, APPLIANCES, AND WINDOWS

IMPORTANT NOTE:
 IT IS AGREED THAT ALTHOUGH EVERY EFFORT HAS BEEN MADE IN PREPARING AND CHECKING THESE PLANS FOR ACCURACY, THE GENERAL CONTRACTOR/OWNER MUST REVIEW ALL DIMENSIONS, DETAILS AND NOTES BEFORE BEGINNING ANY CONSTRUCTION AND IS HEREBY HELD RESPONSIBLE FOR ANY DISCOVERED DISCREPANCIES.
 CONCRETE CONTRACTOR AND BUILDER ARE RESPONSIBLE TO DETERMINE SITE SOIL CONDITIONS AND FOLLOW STANDARDS PER SP8 320.24. THE MOST RESTRICTIVE STANDARDS OF SP8 32.5 - SP8 32.18, ACI 318.4, AND ACI 332-14 FOR ALL FOOTING & WALL REINFORCEMENT. IF NEEDED, MUST BE FOLLOWED.
 ASSUMED SOIL CAPACITY IS 3,000 PSF. FTG. SIZES MUST BE ADJUSTED FOR VARYING SITE DETERMINED SOIL BEARING CONDITIONS.
 ALL LUMBER IN PERMANENT CONTACT W/ CONCRETE MUST BE PRESSURE TREATED LUMBER AS PER U1 SP8 32.10 DUE TO UNKNOWN GRADE CONDITIONS. ACTUAL STEPS IN FOUNDATION WALLS AND LOCATION OF WINDOW WELLS TO BE DETERMINED ON SITE BY GENERAL CONTRACTOR.
 FRAMER IS RESPONSIBLE FOR TRANSFERRING POINT LOADS FROM ABOVE THROUGH THE FLOOR SYSTEM(S) AND WALLS W/ SOLID BLOCKING DOWN TO CONCRETE FOUNDATION WALLS BELOW.
 PLAN IS DRAWN ACCORDINGLY FOR 2 3/4" CASING
 ALL DIMENSIONS SHOWN ARE FROM STUD TO STUD
 BUILDER TO PROVIDE ATTIC SCUTTLE AND LOCATION
 FIRE SEPARATION MUST BE PROVIDED BETWEEN HOUSE AND GARAGE (SEE CODE FOR DETAILS)
 ALL CABINET LAYOUTS ARE CONCEPTUAL. CONSULT CABINET DESIGNER/ PROVIDER FOR EXACT SIZES AND LOCATIONS OF CABINETS, APPLIANCES, AND WINDOWS

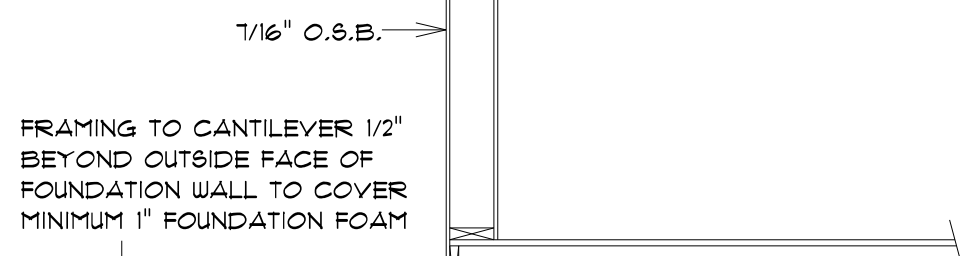

BOX SILL DETAIL
 SCALE: 1/2" = 1'-0"

STAY GREEN BAY

CUSTOMER DESIGNED FOR:

JOB NAME: 555 JIBK 4 JILL Basement Steps
 DATE: MAY 9, 2022
 DRAWN BY: Chris Schuette
 PLAN #: 22-1179-R
 REVISIONS:
 1/22 BY

STAY GREEN BAY


MAILING ADDRESS:
 P.O. BOX 10001
 GREEN BAY, WI 54907-0001

OFFICE:
 WISCONSIN ROAD
 GREEN BAY, WI 54903
 PHONE (920)436-5080
 FAX (920)436-5084


COMPONENTS:
 GREEN BAY TRUSSE
 GREEN BAY, WI 54903
 PHONE (920)436-5084
 FAX (920)436-5084

Wisconsin
 BUILDING SUPPLY


SQUARE FOOTAGE:	
FIRST FLOOR:	2007
GARAGE:	1131
COVERED PORCH:	200
FINISHED BASEMENT:	1128

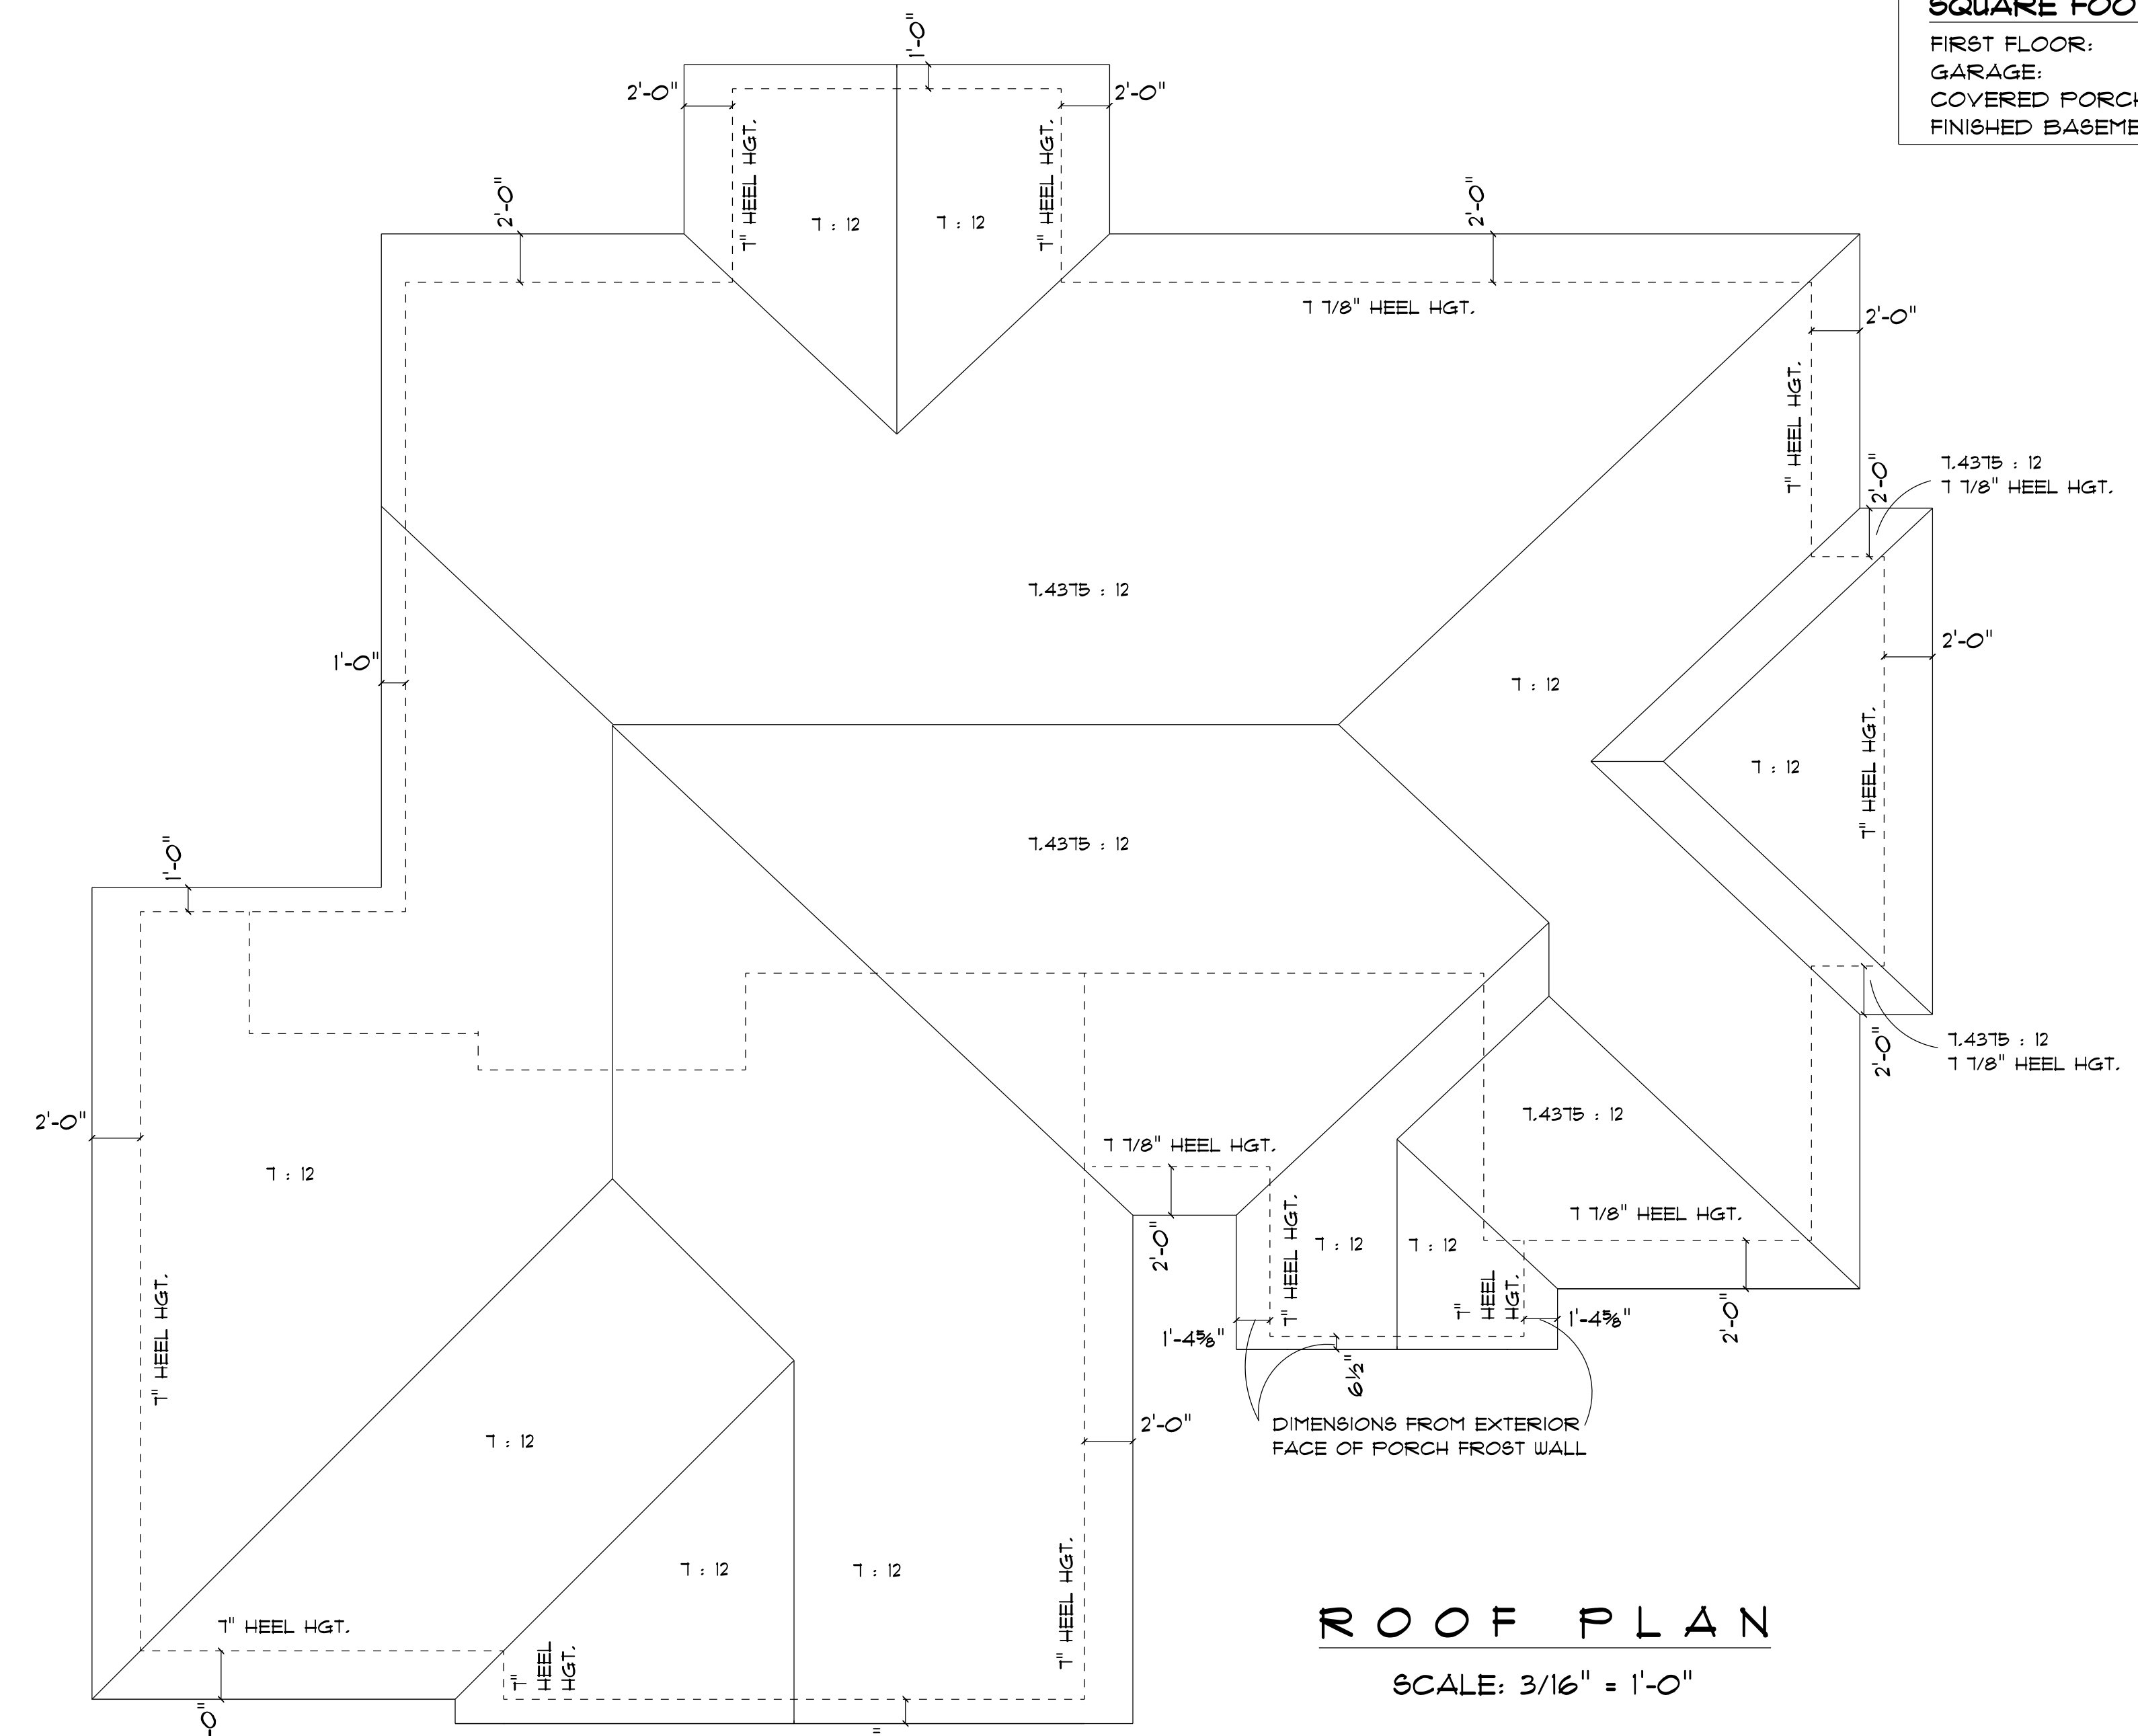

ROOF PLAN
SCALE: 3/16" = 1'-0"

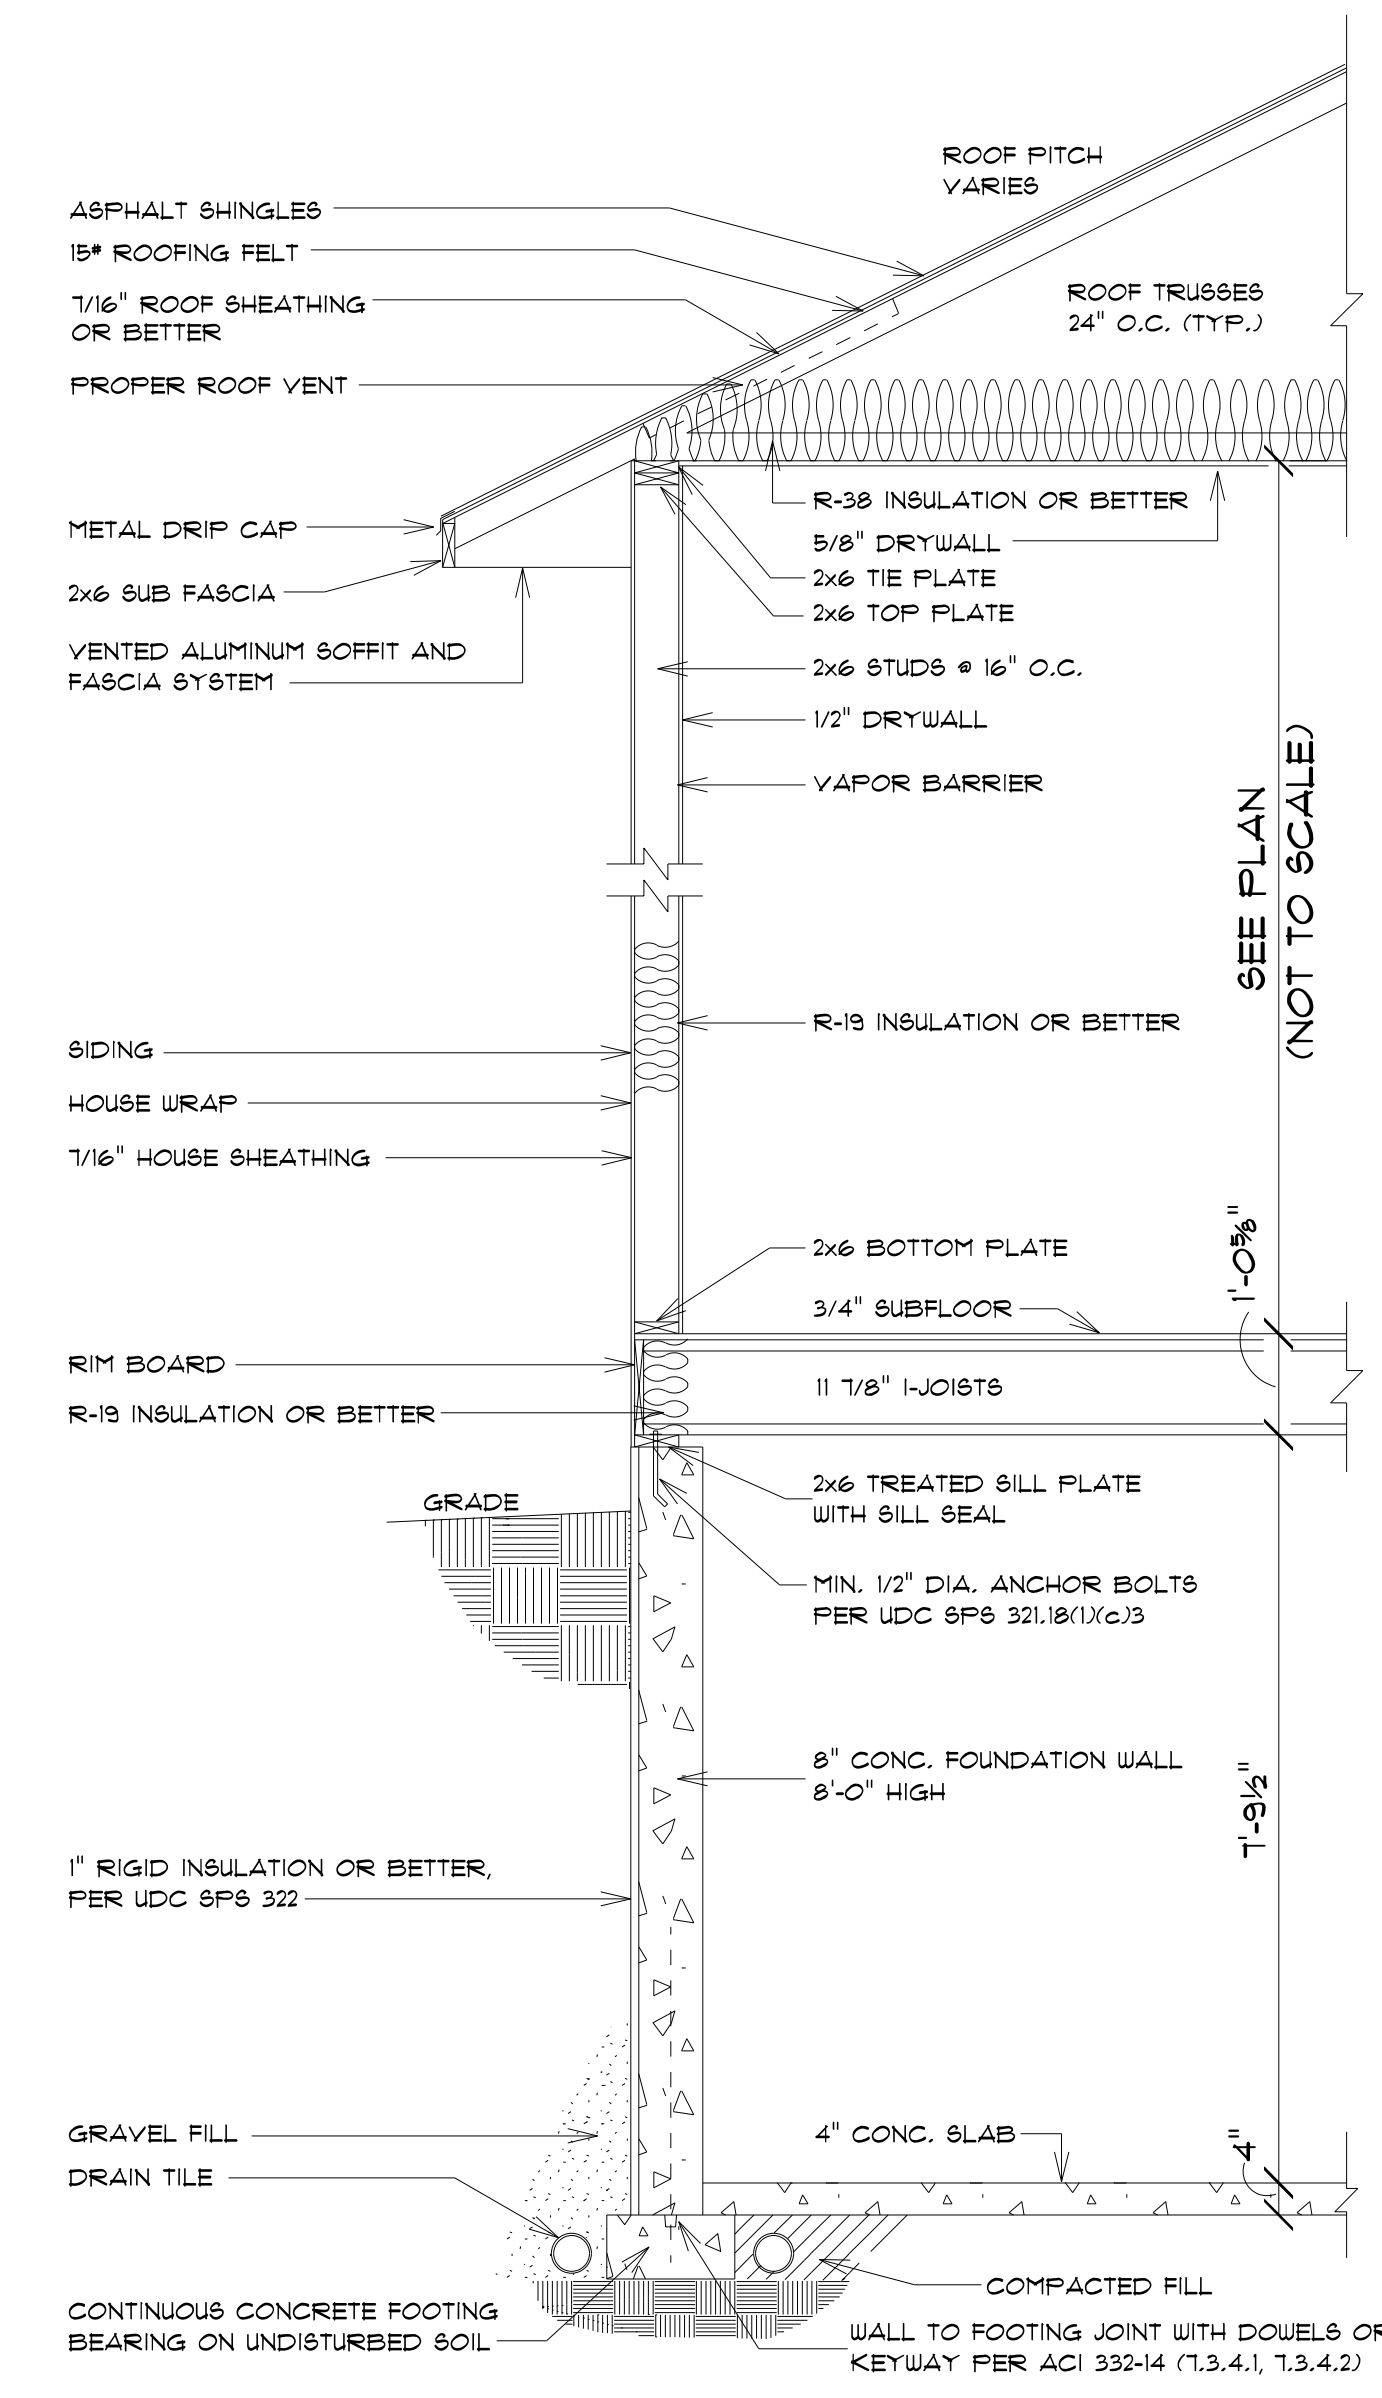

TYPICAL RANCH SECTION
SCALE: 1/2" = 1'-0"
ALL ITEMS TO BE VERIFIED BY CONTRACTOR

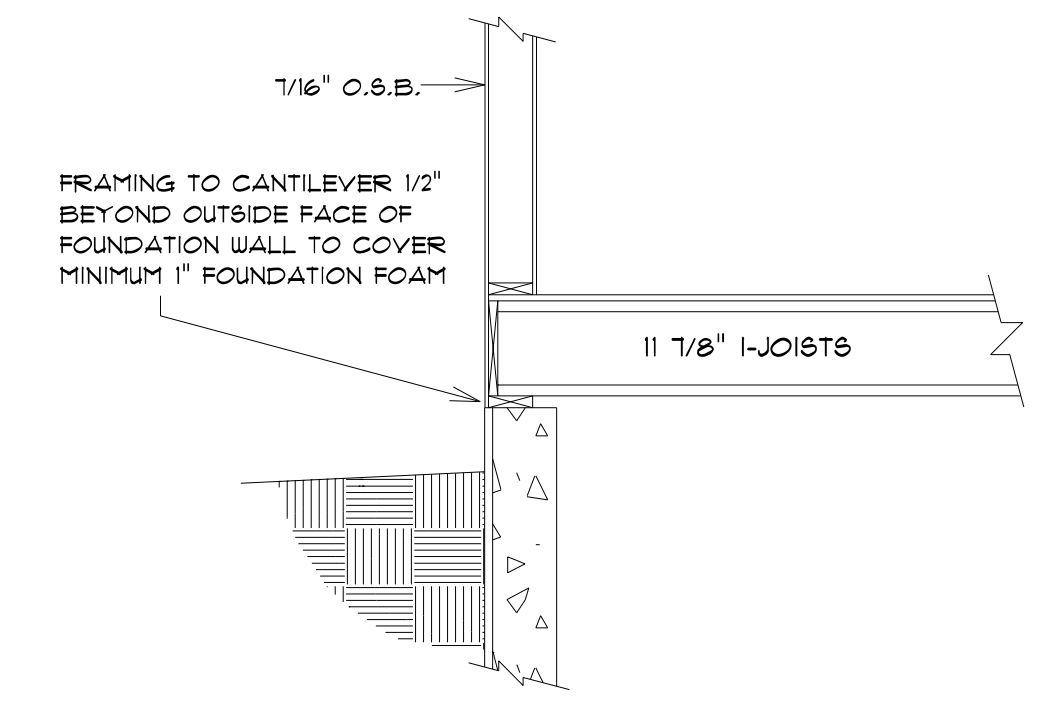

BOX SILL DETAIL
SCALE: 1/2" = 1'-0"

CUSTOMER DESIGNED FOR: STAY GREEN BAY

JOB NAME:	508 JWBK 4 JWB Basement Steps
DATE:	MAY 9, 2022
DRAWN BY:	Chris Schuette
PLAN #:	22-179-R
REVISIONS:	1/22 BY

STAY GREEN BAY

IMPORTANT NOTE:
 * IT IS AGREED THAT ALTHOUGH EVERY EFFORT HAS BEEN MADE IN PREPARING AND CHECKING THESE PLANS FOR ACCURACY, THE GENERAL CONTRACTOR/OWNER MUST REVIEW ALL DIMENSIONS, DETAILS AND NOTES BEFORE BEGINNING ANY CONSTRUCTION AND IS HEREBY HELD RESPONSIBLE FOR ANY DISCOVERED DISCREPANCIES.
 * IT IS UNDERSTOOD THAT THE WISCONSIN SAFETY AND PROFESSIONAL SERVICES CODE AND LAYOUT DRAWINGS FOR FLOOR AND ROOF TRUSSES SHALL TAKE FINAL PRECEDENCE OVER THESE ARCHITECTURAL PLANS.


MAILING ADDRESS:
 P.O. BOX 10001
 GREEN BAY, WI 54307-10001
 OFFICE:
 GREEN BAY, WI 54303
 GREEN BAY, WI 54303
 PHONE (920)436-5080
 FAX (920)434-9570
 COMPONENTS:
 GREEN BAY, WI 54303
 PHONE (920)436-5080
 FAX (920)434-9570

Wisconsin
BUILDING SUPPLY

SQUARE FOOTAGE:

FIRST FLOOR:	2001
GARAGE:	1131
COVERED PORCH:	200
FINISHED BASEMENT:	1128


**FIGURE 321.25-A
PF / CS-PF - PORTAL FRAME BRACE CONSTRUCTION**

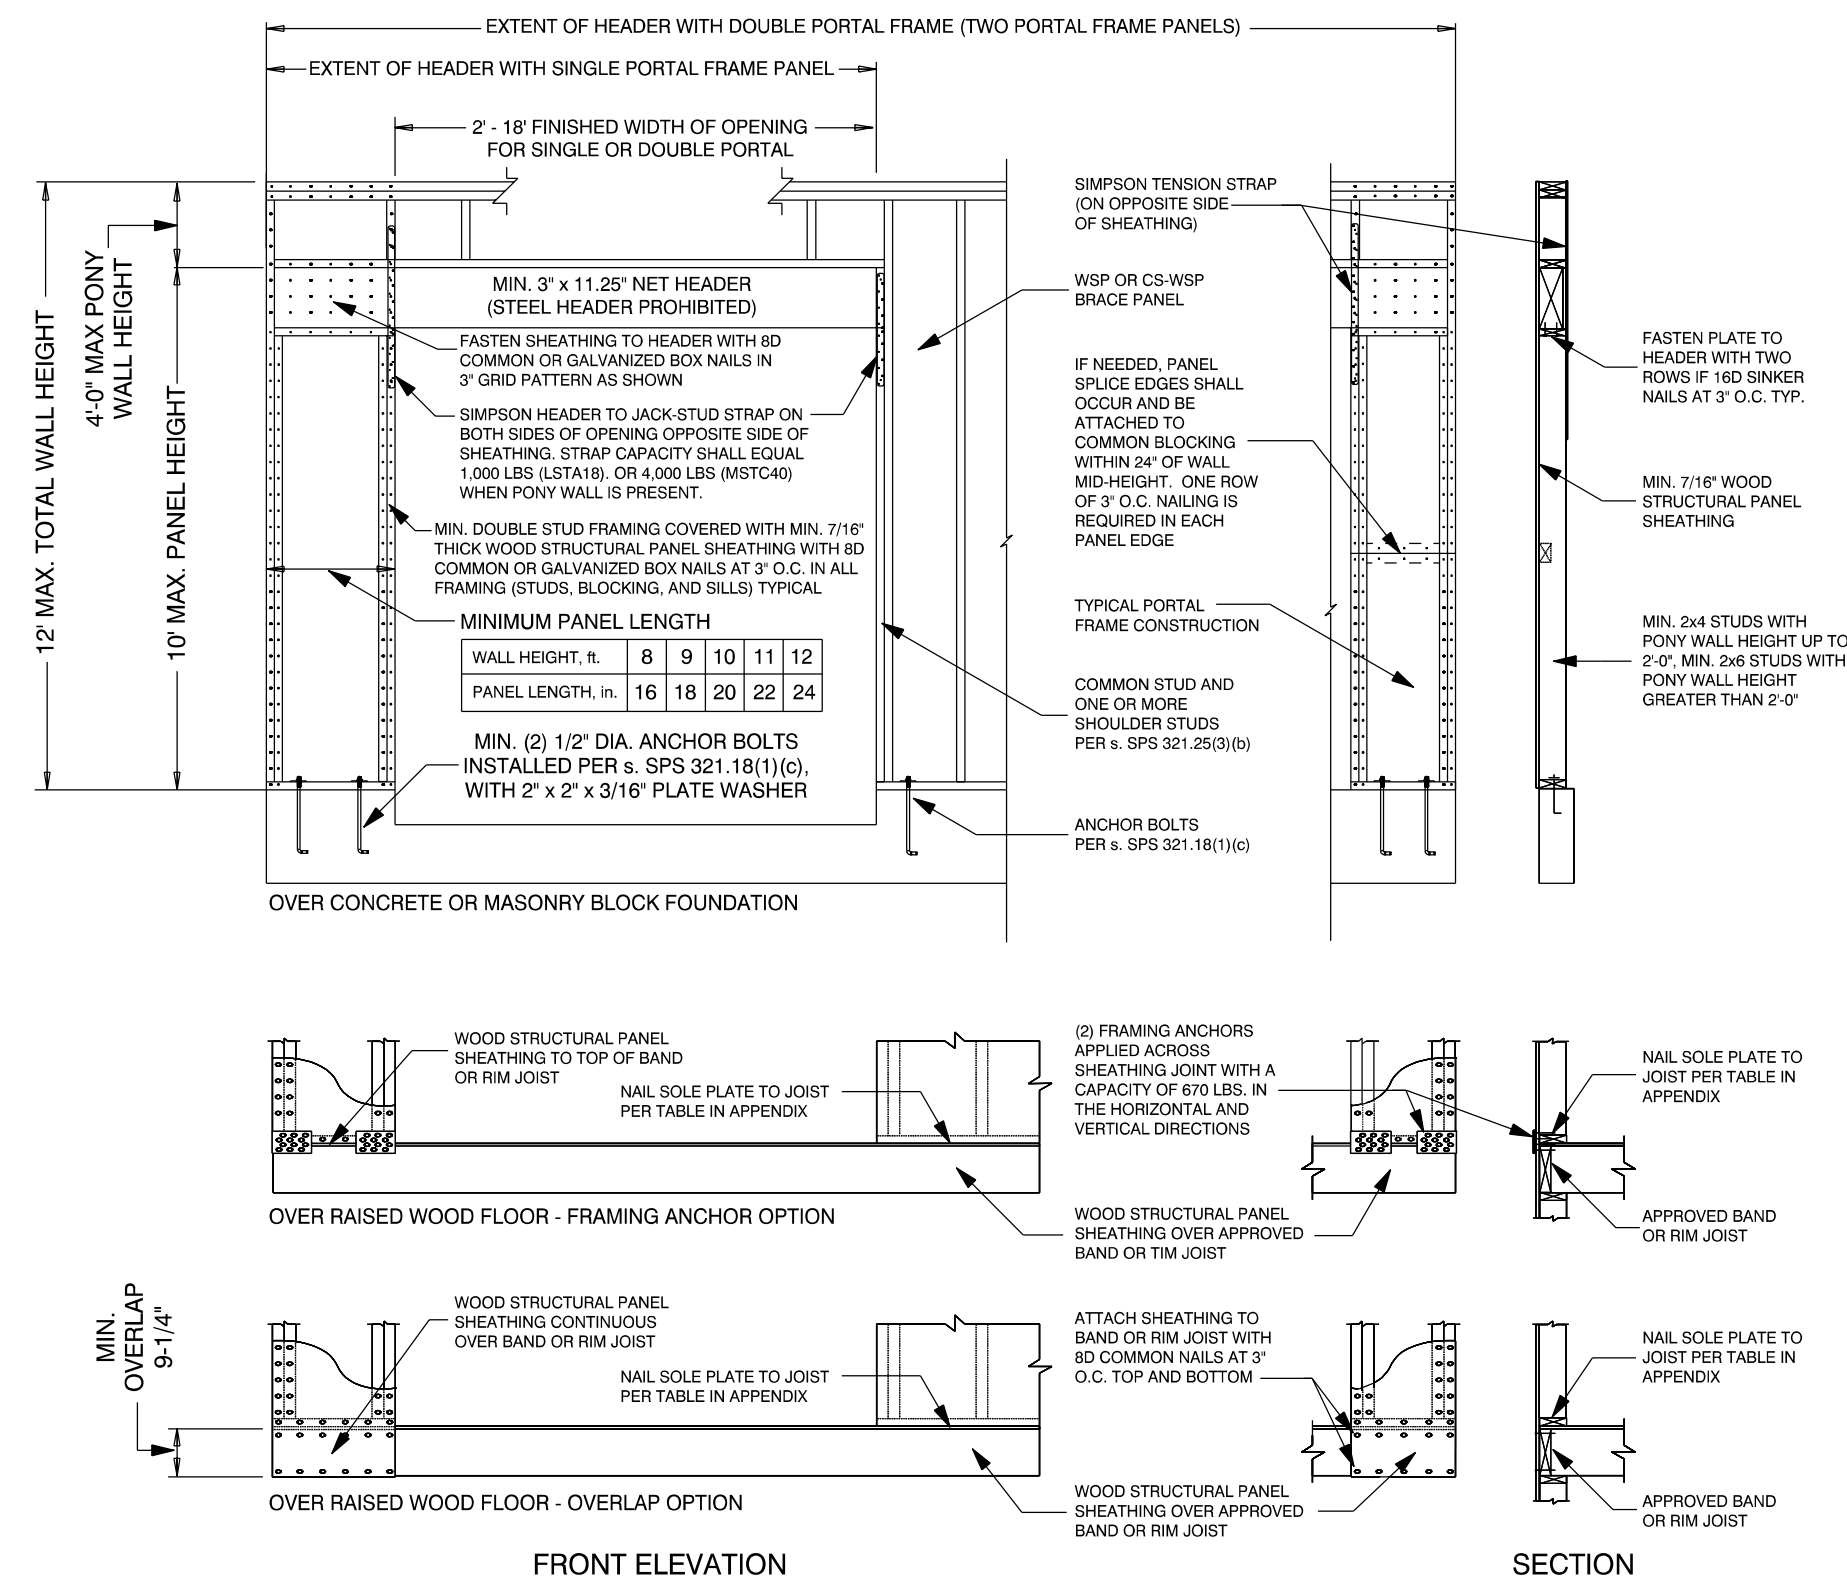

NOTE: STEEL HEADERS ARE PERMITTED IF DESIGNED BY STRUCTURAL ANALYSIS.
NOTE: AS SHOWN IN THE ABOVE CROSS SECTION, 1/2" GYPSUM WALL BOARD IS NOT REQUIRED ON THE INTERIOR SIDE OF THE WALL.

TOTAL ADJACENT SIDE LENGTH: 72'-0 1/2"
BRACING METHOD: CONTINUOUSLY SHEATHED
EXPOSURE CATEGORY: C
TOTAL PANEL LENGTH REQUIRED: 21'-0 3/4" (INTERPOLATED)
TOTAL PANEL LENGTH PROVIDED: 21'-6"

TOTAL ADJACENT SIDE LENGTH: 66'-6 1/2"
BRACING METHOD: CONTINUOUSLY SHEATHED
EXPOSURE CATEGORY: C
TOTAL PANEL LENGTH REQUIRED: 21'-0 3/4" (INTERPOLATED)
TOTAL PANEL LENGTH PROVIDED: 21'-6"

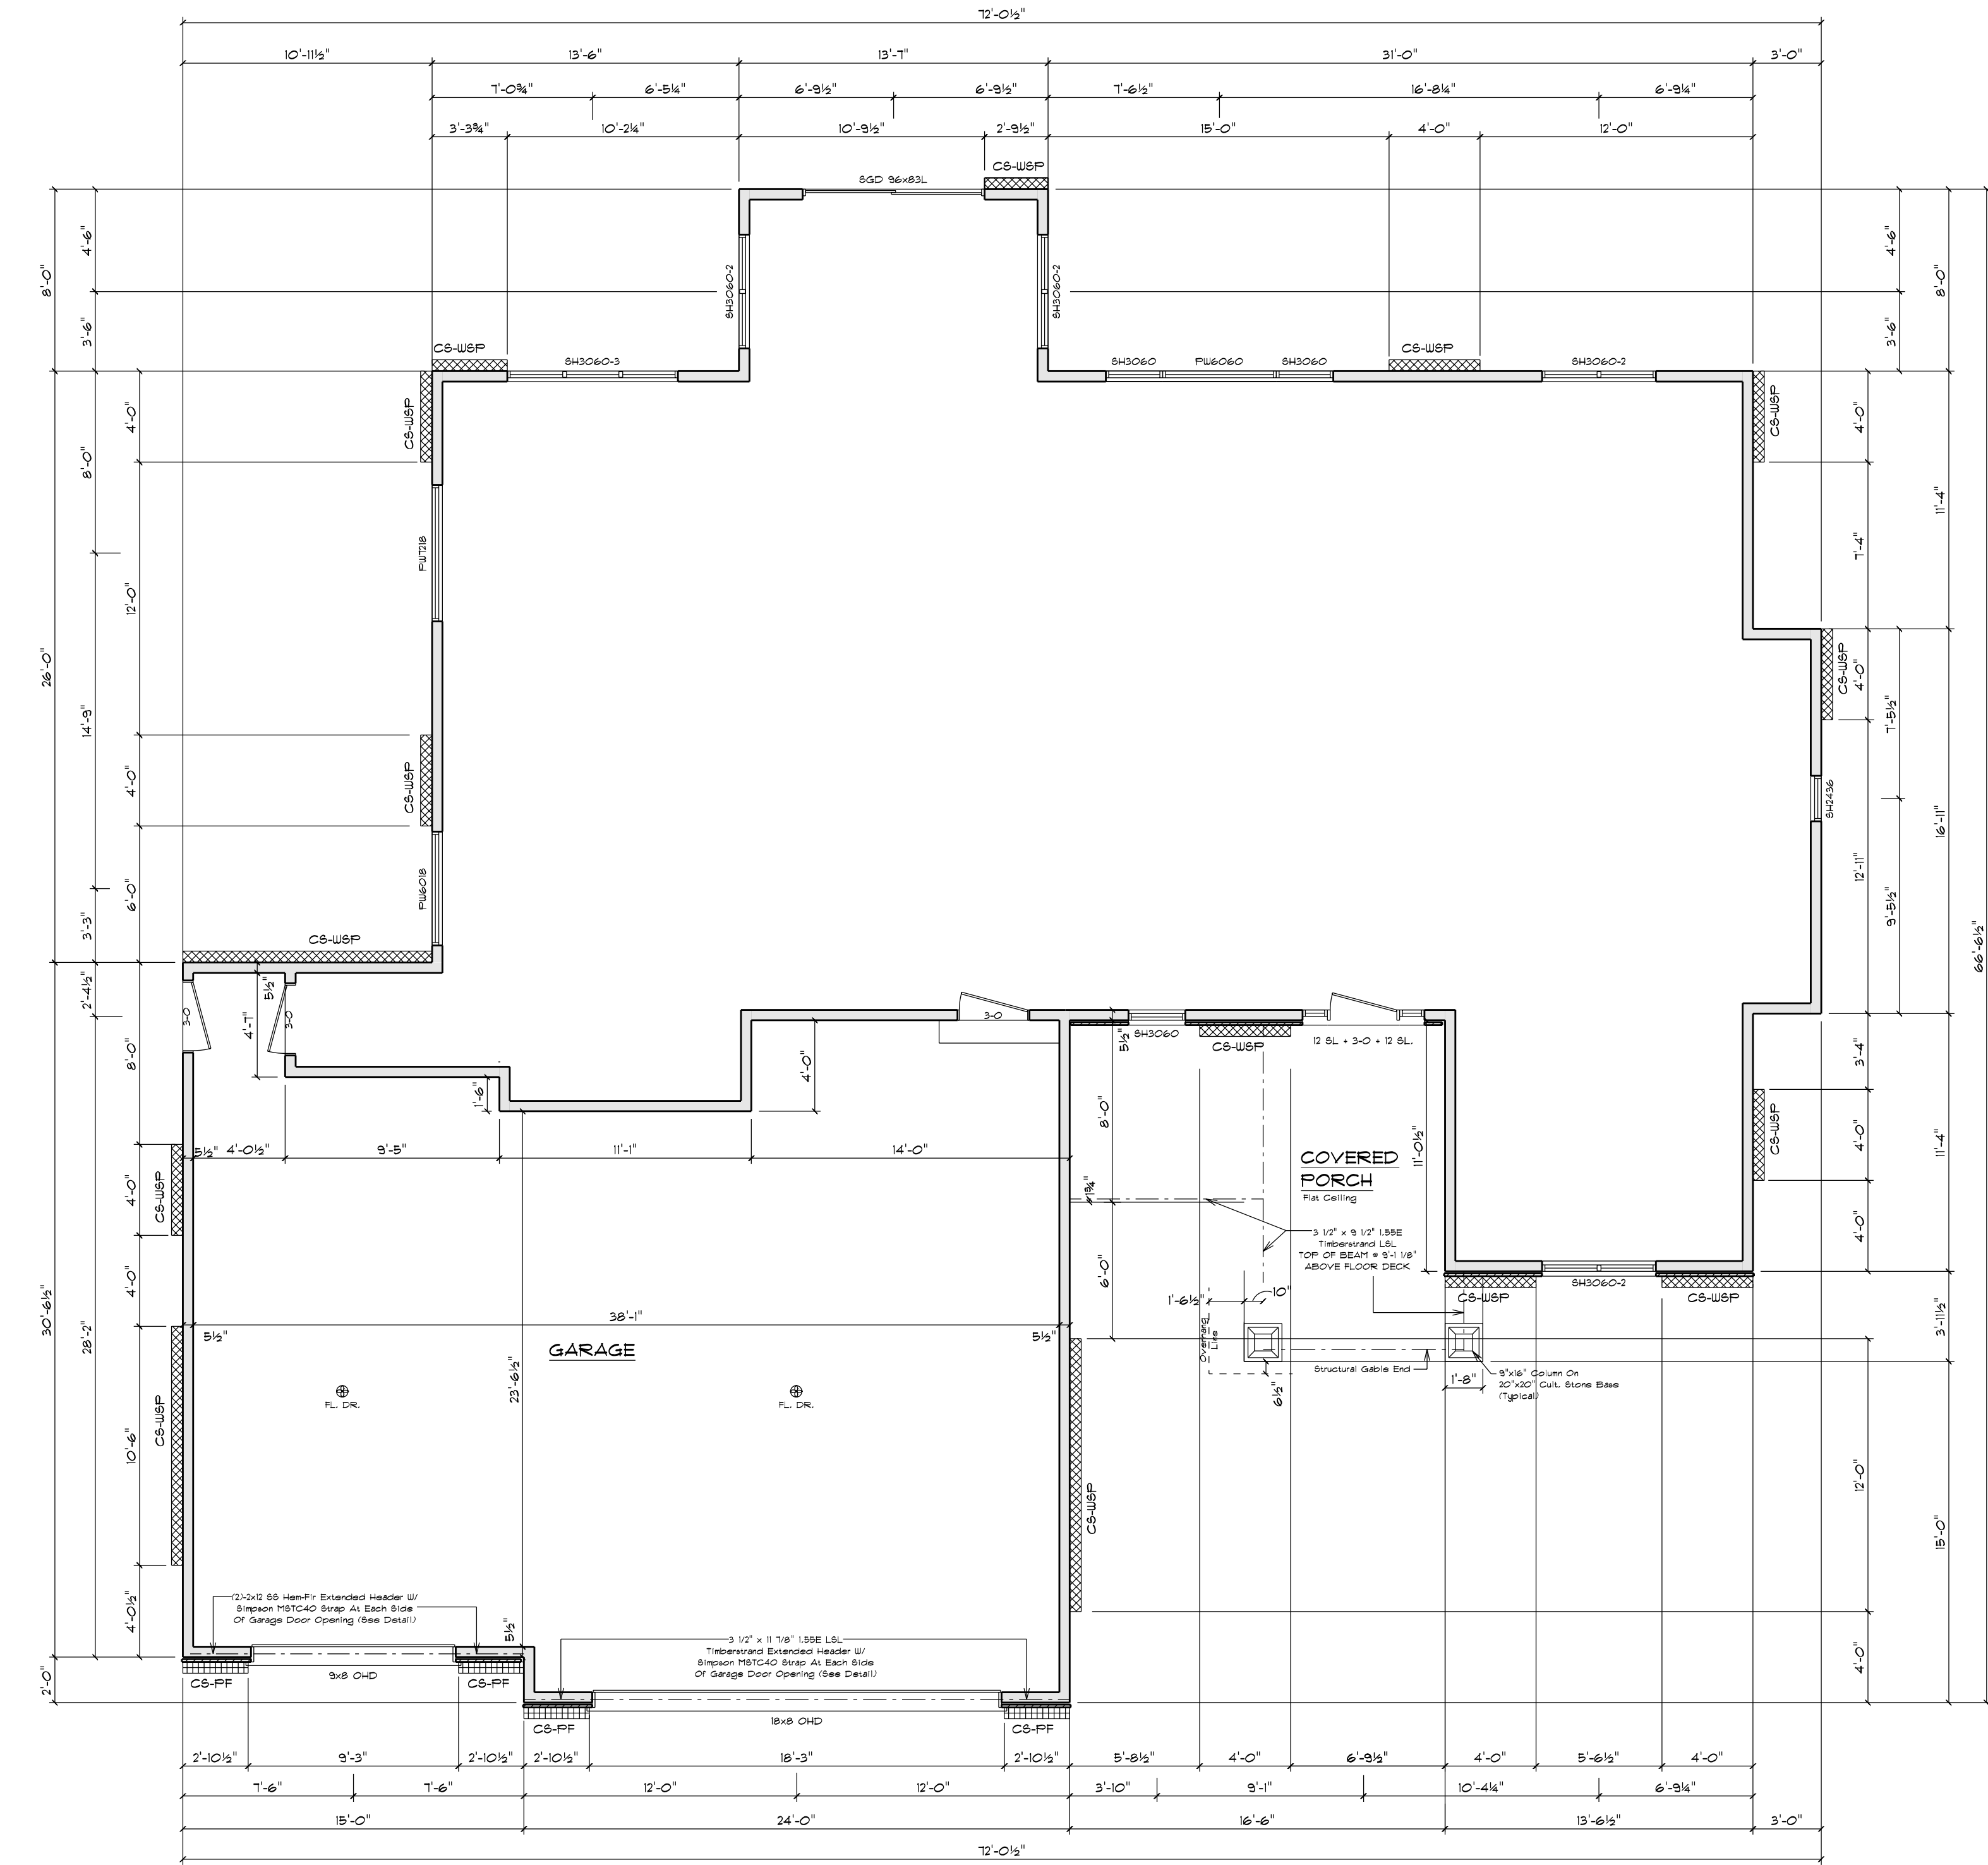

TOTAL ADJACENT SIDE LENGTH: 66'-6 1/2"
BRACING METHOD: CONTINUOUSLY SHEATHED
EXPOSURE CATEGORY: C
TOTAL PANEL LENGTH REQUIRED: 19'-8" (INTERPOLATED)
TOTAL PANEL LENGTH PROVIDED: 23'-6"

NOTE:
THIS FLOOR PLAN TO BE USED FOR
WALL BRACING PURPOSES ONLY.

WALL BRACING LAYOUT PLAN

Scale: 3/16" = 1'-0"
House Wall Ht.: 9'-1 1/8"
Garage Wall Ht.: 10'-3 1/4"
Top-Of-Wall-To-Ridge Ht.: 11'-5"
Exterior Stud Spacing: 16" O.C.
Seismic Design: B

NOTE:
THIS FLOOR PLAN TO BE USED FOR
WALL BRACING PURPOSES ONLY.

GENERAL NOTES:

- WALL BRACING, SPS 321.25 (8)
- CIRCUMSCRIBED RECTANGLES: EACH FLOOR PLAN LEVEL SHALL BE CIRCUMSCRIBED WITH ONE OR MORE RECTANGLES AROUND THE ENTIRE FLOOR PLAN AT THE FLOOR LEVEL UNDER CONSIDERATION. WHEN MULTIPLE RECTANGLES ARE USED, EACH SIDE SHALL BE BRACED AS THOUGH IT WERE A SEPARATE BUILDING AND THE BRACING AMOUNT ADDED TOGETHER ALONG THE COMMON WALL WHERE ADJACENT RECTANGLES OVERLAP OR ABUT.
- BRACED WALL PANEL (BWP) LOCATIONS: WITHIN 12" FROM EACH SIDE AND 2" FROM PANEL EDGE TO PANEL EDGE (SEE FIGURE 321.25-C).
- ALL EDGES OF PANEL-TYPE BRACING, EXCEPT HORIZONTAL JOINTS IN GB BRACING, SHALL BE ATTACHED TO FRAMING OR BLOCKING.
- THE INTERIOR SIDE OF ALL EXTERIOR WALLS SHALL BE SHEATHED WITH MINIMUM 1/2" GYPSUM WALLBOARD UNLESS OTHERWISE PERMITTED TO BE EXCLUDED BY THIS SUBSECTION. (THIS REQUIREMENT IS EXCLUDED IN PORTAL FRAME METHOD).
- BRACING WITH CS-WSP SHALL HAVE SHEATHING INSTALLED ON ALL SHEATHABLE SURFACES ABOVE, BELOW, AND BETWEEN WALL OPENINGS.
- EACH BRACED WALL PANEL MAY CONTAIN NO MORE THAN ONE HOLE, HAVING A MAXIMUM DIMENSION OF NO MORE THAN TEN PERCENT OF THE LEAST DIMENSION OF THE PANEL, AND CONFINED TO THE MIDDLE THREE-FIFTHS OF THE PANEL.
- BLOCKING AND BRIDGING: 2x18 BRIDGING USED AT PARALLEL BOX SILL AND FLOOR JOIST BRIDGING (@ 32" O.C.) IS THE SAME DEPTH AS THE JOIST.
- WHERE JOISTS ARE PERPENDICULAR TO BWL'S ABOVE OR BELOW, BLOCKING SHALL BE PROVIDED BETWEEN THE JOISTS AT BWP LOCATIONS TO PERMIT FASTENING OF WALL PLATES WITH 16d NAILS @ 16" O.C.
- WHERE JOISTS ARE PARALLEL TO BWL'S ABOVE OR BELOW, A RIM JOIST OR OTHER PARALLEL FRAMING MEMBER SHALL BE PROVIDED AT THE BWP TO PERMIT FASTENING OF WALL PLATES WITH 16d NAILS @ 16" O.C.

WALL BRACING MATERIAL LEGEND

	(CONTINUOUSLY SHEATHED WOOD STRUCTURAL PANEL) 3/8" THICK SHEATHING FOR MAX. 16" O.C. STUD SPACING 1/8" THICK SHEATHING FOR MAX. 24" O.C. STUD SPACING FASTEN WITH 8d COMMON NAIL OR 8d BOX NAIL (2 3/8" LONG x 0.13" DIA.) OR 16d NAIL (2" O.C.) - ORIGIN IN GAGE STUDS, 1 1/4" LONG MAXIMUM FASTENER SPACING: 6" EDGES, 12" FIELD (NAILS) / 3" EDGES, 6" FIELD (STAPLES)
	(CONTINUOUSLY SHEATHED PORTAL FRAME) -REFER TO FIGURE 321.25-A FOR SHEATHING, FASTENER, AND OTHER REQUIREMENTS-

**TABLE 321.25-H ab
MINIMUM WIDTHS OF CS-WSP BRACED WALL PANELS**

MAXIMUM OPENING HEIGHT ADJACENT TO BRACED WALL PANEL	MINIMUM LENGTH OF FULL-HEIGHT BRACED WALL PANEL (INCHES)			
	8'	9'	10'	12'
5' - 4"	24	21	30	36
6' - 8"	32	30	30	36
T - 2" (T Gar. Dr.)	38	35	33	36
8' - 0"	48	41	38	36
8' - 2" (B Gar. Dr.)	-	43	39	37
9' - 0"	-	54	46	41
10' - 0"	-	-	60	48
12' - 0"	-	-	-	72

4. SHEATHING SHALL EXTEND FROM TOP OF THE TOP PLATE TO THE BOTTOM PLATE AND MAY BE MULTIPLE SHEETS. ALL JOINTS SHALL BE BLOCKED.
5. INTERPOLATION IS PERMITTED.

STAY GREEN BAY

MAILING ADDRESS:
P.O. BOX 10001
GREEN BAY, WI 54307-1001

OFFICE:
WISCONSIN E-5043
GREEN BAY, WI 54303
PHONE (920)436-5034
FAX (920)436-5034

COMPONENTS:
WISCONSIN TERRACE
GREEN BAY, WI 54303
PHONE (920)436-5034
FAX (920)436-5034

Wisconsin BUILDING SUPPLY

CUSTOMER DESIGNED FOR:
JOB NAME: 505 Jank & Jill, Basement Steps
DATE: MAY 9, 2022
DRAWN BY: Chris Schuette
REVISED BY: (BASED OFF OF PLAN SHEET)
REVISIONS:
1/222 BY

22-179-R